

Halton Rex RXP, chilled beam – Technical description

Contents

1	Introduction	3
1.1	Copyright and disclaimers	3
1.2	About this document	3
1.3	Summary of changes	3
2	Product description	5
2.1	Overview	5
2.2	Operating principle	6
2.2.1	Halton Coanda wings for exposed installation	9
2.3	Key technical data	10
2.4	Features and options	11
2.5	System package	14
2.5.1	Overview	14
2.5.2	Operating principle	16
2.5.3	Room automation	16
2.5.4	Cooling and heating water valve selection	18
2.6	Quick selection	20
2.7	Structure and materials	22
2.8	Dimensions and weight	24
2.9	Specification	27
2.10	Order code	28
3	Design information	30
3.1	Design considerations	30
3.1.1	Installation	30
3.1.2	Commissioning	33
3.1.3	Maintenance	39
4	Technical reference data	41
4.1	Connection diagrams	41

1 Introduction

1.1 Copyright and disclaimers

This document remains the sole property of Halton and may not be duplicated, borrowed, copied, amended, modified, reproduced, transmitted or distributed to any third party without the prior written consent of Halton. Any information held in this document or associated materials may only be used for the purpose specified in this document.

Halton disclaims any and all liability related to this document. Halton gives no explicit or implied warranties in terms of this document. Any permitted use of the information included herein is at your own risk. Halton may amend or replace the information included in this document at its sole discretion without further notice and liability.

All intellectual property rights or applications thereof, including without limitation copyright, model rights, patents, trade secrets, trade names, trademarks, know-how (whether registered or unregistered) attributable to this document remain the sole and exclusive property of Halton. No rights or licenses are granted.

1.2 About this document

The purpose of this document is to give technical information and design examples for salespersons, technical support and designers.

1.3 Summary of changes

Release	Date	Description
7.1	09-Sep-2026	2.4 Features and option - Added additional duct connections (R4 and L4). 2.9 Order code - Added additional duct connections (R4 and L4).
7.0	01-Sep-2026	- New Length 1 800 mm added to autonomic and flexible model. - Halton Coanda wings added as an option to all models for exposed installation.
6.1	29-Aug-2025	2.9 Order code - changed the order for M = Model (SFA → FAS).
6.0	09-July-2025	3.1.1 Installation - updated text 3.1.2 Commissioning - Updated k-factors for Flexible and Autonomic models. For models delivered before 30.6.2025, see "Halton Rex RXP, chilled beam - k-factors before 30.06.2025" document in the "Downloads" section.
5.0	5-Feb-2024	- RXP/Autonomic model added - RXP/Flexible model updated
4.0	14-Jun-2023	- RXP/Flexible model added and earlier model named as RXP/Standard - RXP/Flexible material added to all chapters

Release	Date	Description
3.0	21-Apr-2022	▪ System package information added. ▪ Duct connection Ø160 mm: Only available if L=1200 and nozzle type=E. ▪ Editorial changes.
2.0	5-Nov-2021	▪ A new coil type added: cooling and heating. ▪ A new duct connection size added: Ø 160 mm.
1.0	15-Dec-2020	First version.

2 Product description

2.1 Overview



Compact, fully flexible constant air volume (CAV)/variable air volume (VAV) chilled beam with 4-way air distribution for suspended ceilings. Ensures quiet and pleasant room conditions even at higher cooling capacities.

Application area

- Cooling, heating, and ventilation in offices, hospital rooms, schools, and public spaces.
- Can be used in CAV and demand-based VAV ventilation systems.

Key features

- Active chilled beam with 4-way air distribution.
- Three product models with adjustable airflow using manual CAV or motorised VAV actuators
 - Standard model with boost airflow control and pressure-dependent operation
 - Flexible model with 0-100% airflow control and pressure-dependent operation
 - Autonomic model with 0-100% airflow control and pressure-independent operation
- The throw pattern expanded to corners, ensuring pleasant room conditions even with high cooling capacities.
- Halton Coanda wings generates optimal throw pattern for exposed installation (optional)
- Model with Halton Workplace WRA, room automation system package.

2.2 Operating principle

The primary supply air enters the plenum of the Halton Rex RXP chilled beam, from which it is diffused into the room through the nozzles and supply slots. The air jets from the nozzles efficiently induce ambient room air through the heat exchanger, where the air is cooled or heated by means of the water circulating within the heat exchanger. The supply slots direct the air jets horizontally along the ceiling surface, preventing the feeling of draught.

The blue arrows in *Fig. 1* show the supply air coming through the supply slots. The red arrows show the ambient room air going through the front panel and the heat exchanger.

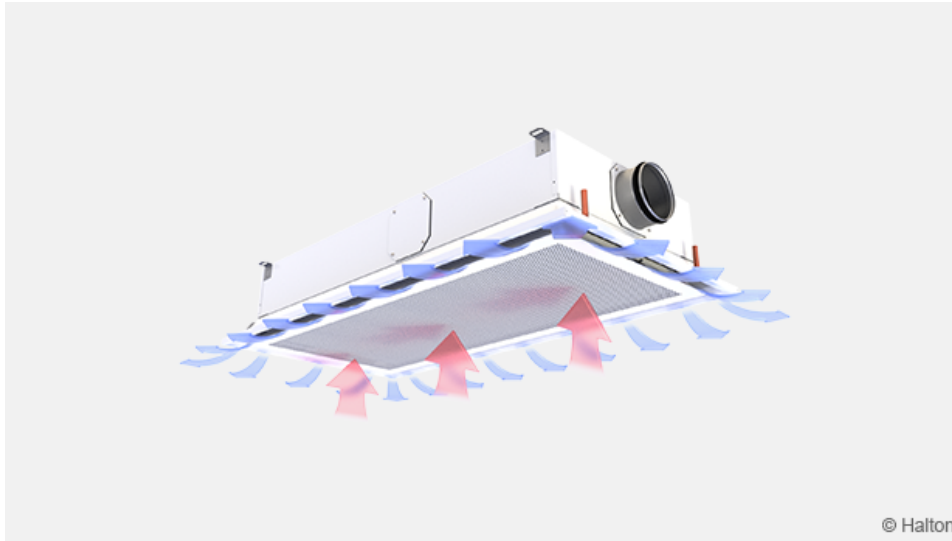


Fig. 1. Operating principle of the Halton Rex RXP chilled beam

Halton Air Quality (HAQ) control in Halton Rex RXP, Standard model

Halton Air Quality (HAQ) boost airflow control is used to adjust or control the rate of additional supply airflow in a room space. Under normal conditions, fresh air is supplied through the nozzles. Whenever additional air is needed (boost/VAV function), the HAQ control opens and provides more air. VAV stands for Variable Air Volume.

The HAQ control can also be used as a Constant Air Volume (CAV) damper, allowing for the adjustment of the k-factor to achieve the correct airflow at a specific pressure level. This eliminates the need to change or plug the nozzles of the Halton Rex RXP chilled beam.

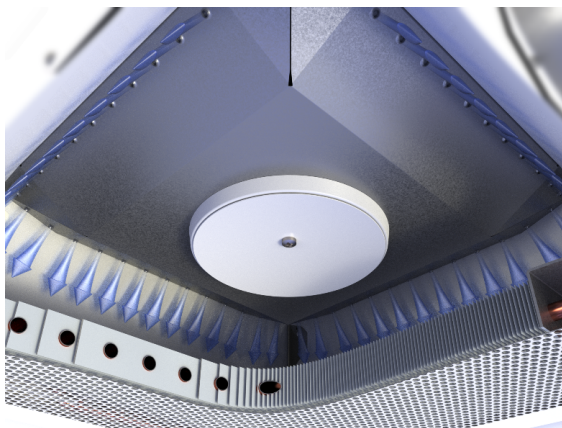


Fig. 2. VAV function: Supply air from nozzles (normal mode)

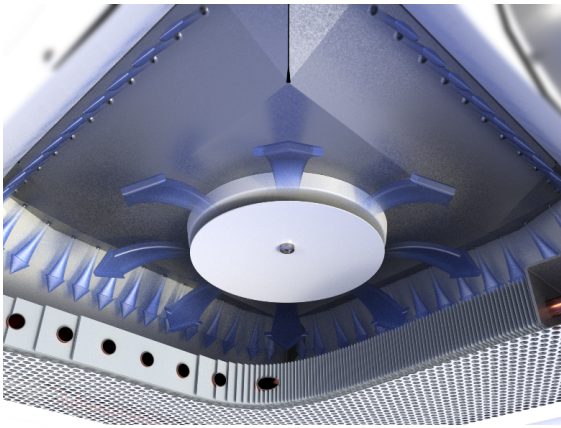


Fig. 3. VAV function with HAQ control: Supply air from nozzles and HAQ control (boost mode)

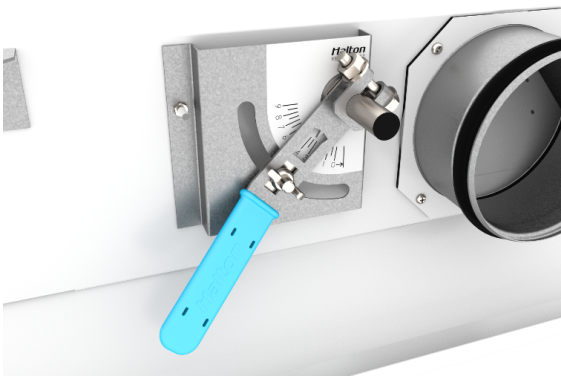


Fig. 4. Adjustment of the manual actuator of HAQ control in Halton Rex RXP, Standard model

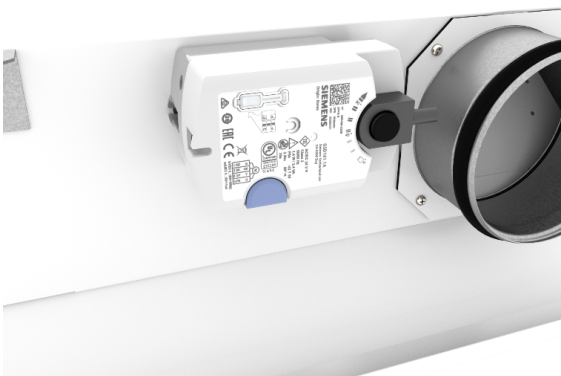


Fig. 5. Electric actuator of HAQ control in Halton Rex RXP, Standard model

Halton Operation Mode Damper (OMD) in Halton Rex RXP, Flexible model

The Halton Operation Mode Damper (OMD) offers fully flexible airflow control suitable for manual supply airflow adjustment or motorised Variable Air Volume (VAV) control of the supply airflow rate. The OMD control flexibly combines nozzle and HAQ airflow control, providing complete airflow flexibility with one nozzle configuration.

The OMD control can be used as a Constant Air Volume (CAV) damper, allowing for the adjustment of the k-factor to achieve the correct airflow at a specific pressure level. This eliminated the need to change or plug the nozzles of the Halton Rex RXP chilled beam.

When the OMD control is equipped with a motorised actuator, fully flexible VAV control is achieved. It allows different VAV modes, with for instance minimum, normal and boost airflow settings.

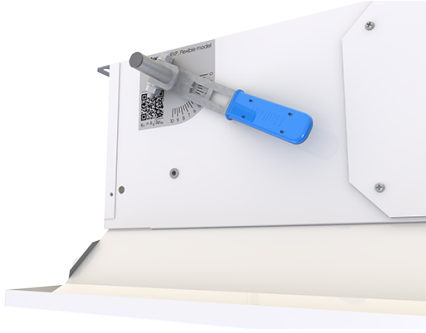


Fig. 6. Adjustment of the manual actuator of OMD control in Halton Rex RXP, Flexible model

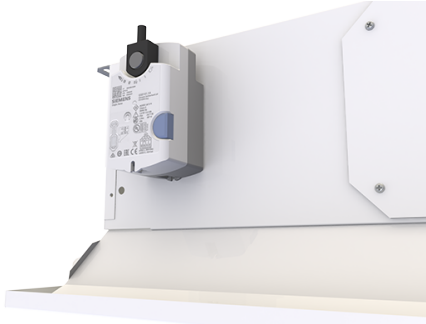


Fig. 7. Electric actuator of OMD control in Halton Rex RXP, Flexible model

Halton Operation Mode Damper (OMD) in Halton Rex RXP, Autonomic model

Halton Operation Mode Damper (OMD) fully flexible airflow control is used for manual supply airflow adjustment or for motorised Variable Air Volume (VAV) control of the supply airflow rate. The OMD control flexibly combines nozzle and HAQ airflow control providing full airflow flexibility with one nozzle configuration.

In Halton Rex RXP, Autonomic model, when the OMD control is equipped with a motorised actuator integrated with pressure measurement, fully flexible VAV control with pressure independent operation is achieved. It allows different VAV modes with for instance minimum, normal and boost airflow settings.

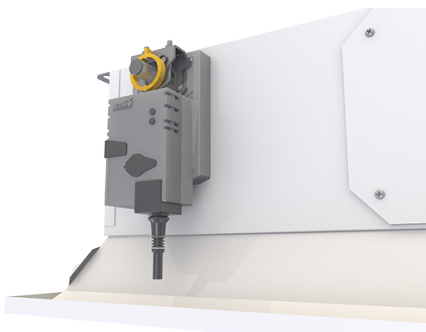


Fig. 8. Electric actuator integrated with pressure measurement of OMD control in Halton Rex RXP, Autonomic model

Velocity control in the occupied zone

Halton Rex RXP, Flexible and Autonomic models can be equipped with Halton Velocity Control (HVC). It is used for adjusting room air velocity conditions either when the room layout is changed (e.g., in cases where the partition wall is located near the chilled beam) or when local, individual velocity conditions need to be altered. HVC adjustment affects the induced room airflow through the heat exchanger, and therefore, it either increases or decreases both the velocities in the occupied zone and the cooling or heating capacity of the chilled beam.

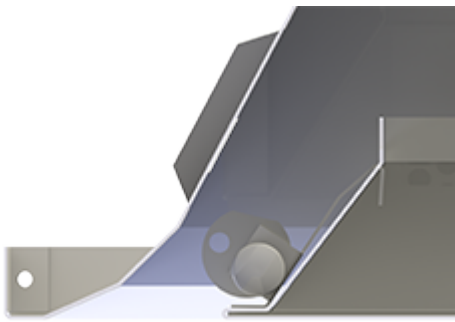


Fig. 9. HVC is in position Normal

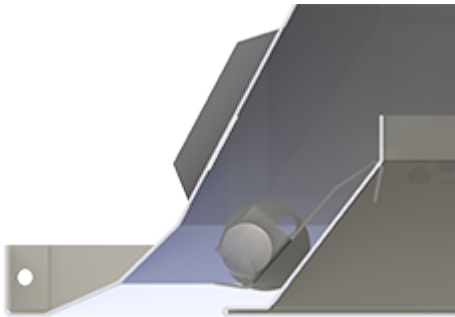


Fig. 10. HVC is in position Throttle

There are HVC controls on all four sides of the Halton Rex RXP chilled beam. The HVC is divided into two parts for RXP-1200 and three parts for RXP-1800 along the long sides of the chilled beams. This enables the adjustment of conditions in different parts of the occupied zone.

2.2.1 Halton Coanda wings for exposed installation

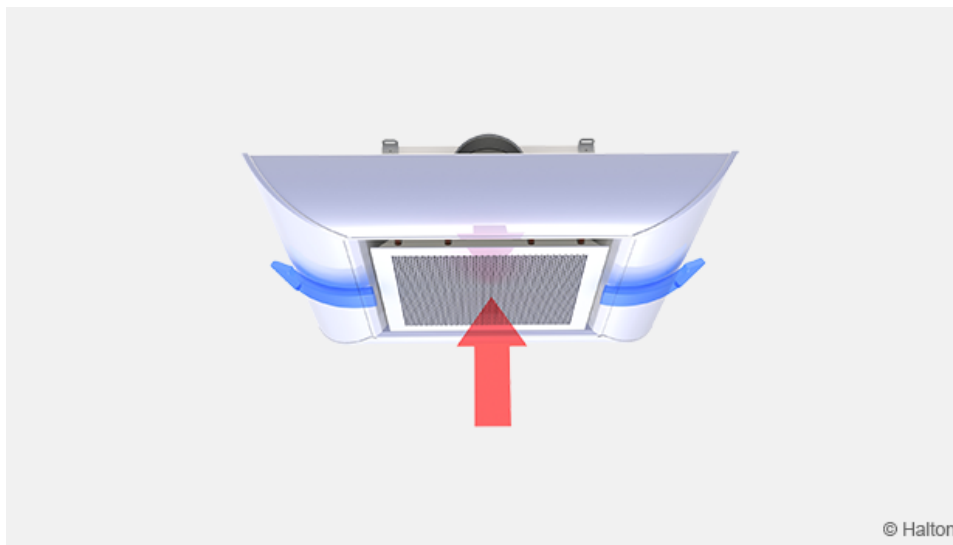


Fig. 11. Halton Coanda wings installed for Halton Rex RXP 600 model

Halton Rex RXP can be designed for exposed installation by selecting optional Halton Coanda wings (Fig. 11). Without optimally curved Halton Coanda wings, using only a box-shaped design with small guiding surfaces around the chilled beam, cool supply air jets collide directly with the occupied zone, posing a potential draught risk. With curved Halton Coanda wings, supply air jets can be turned upward, where they are diffused into room air efficiently and generate a similar room air velocity level to that in the ceiling-integrated installation of

Halton Rex RXP.

This guided airflow maintains higher momentum along the ceiling, promoting better mixing with room air before it descends.

2.3 Key technical data

Feature	Description
Airflow rate	Max. airflow rate 57 l/s or 205 m ³ /h (RXP/S-E-1200); 65 l/s or 234 m ³ /h (RXP/F-F-1200 and RXP/A-F-1200); 92 l/s or 331 m ³ /h (RXP/F-F-1800 and RXP/A-F-1800) < 35 dB @70pa
Dimensions	600 x 600 mm, 1200 x 600 mm and 1800 x 600 mm
Water pressure drop	Max. 11 kPa (RXP-600, waterflow 0.1 kg/s)
	Max. 18.6 kPa (RXP-1200, waterflow 0.1 kg/s)
	Max. 25.1 kPa (RXP-1800, waterflow 0.1 kg/s)
Cooling capacity	Up to 1700 W (RXP/S-E-1200, 100 Pa, 57 l/s, water inlet 14 °C, water mass flow 0.1 kg/s, supply air 16 °C)
Weight	10 - 22 kg (RXP/S) and 17- 42 kg (RXP/F and RXP/A)
Typical total pressure drop	60 - 80Pa
Typical water inlet temperature	- Cooling: 15–17 °C (must be above dew point) - Heating: 30–50 °C

2.4 Features and options

Category	Feature (order code)	Option (order code)>	Description
Product model	Model M	S	Standard product model with nozzle and HAQ airflow control options.
Size and orientation	Product length L	600, 1200	Two different lengths. Nominal width is always 600 mm.
	Duct connection E	S2, R2, L2	Ø125 mm. Factory-positioned straight, right, or left. Position can be changed on site. See the figure below.
		S3, R3, L3	Ø160 mm. Factory-positioned straight, right, or left. Position can be changed on site. See the Fig. 12. Note: Only available if L=1200 and nozzle type=E.
Cooling / heating	Coil type TC	C	Cooling coil. Connection pipes: 2 x Ø12 mm.
		H	Cooling and heating coil. Connection pipes: 4 x Ø12 mm.
Airflow	Nozzle type S	C, D, E	3 options for different airflow or k-factor needs. Nozzle C is the smallest and nozzle E the largest.
	Control type CN	NA	No HAQ. The k-factor is determined by nominal size and nozzle selection (CAV).

Category	Feature (order code)	Option (order code)>	Description
		MA	Manually adjustable CAV control of additional airflow. Standard air from nozzles, additional air from HAQ.
		M1	Motorised VAV control of additional airflow. Standard air from nozzles, additional air from HAQ.
Room air velocity level	Velocity control (HVC) VC	N	No HVC function.
Exposed installation	Halton Coanda wings CE (See Fig. 13)	N	No Halton Coanda wings
		Y	Yes, installation included. Note: When selected, the RXP-600/1200 product height is 255 mm, with a d125 connection.

Table 1. Halton Rex RXP, Standard model (RXP/S)

Category	Feature (order code)	Option (order code)	Description
Product model	Model M	F	Flexible product model with fully flexible OMD airflow control option
		A	Autonomic product model with fully flexible OMD airflow control options integrated with pressure measurement.
Size and orientation	Product length L	600, 1200, 1800	Three different lengths. Nominal width is always 600 mm.

Category	Feature (order code)	Option (order code)	Description
	Duct connection E	S3, R3, L3, S4, R4, L4	Ø160 or 200 mm. Factory-positioned straight, right, or left. Position can be changed on site. See Fig. 12. Note: Ø160 is available only when L=600 or L=1200. While Ø200 is available only when L=1800.
	Connection type (air and water) CT	S	Air and water connections at the same end.
		O	Water connections at the opposite end.
Cooling / heating	Coil type TC	C	Cooling coil. Connection pipes: 2 x Ø12 mm.
		H	Cooling and heating coil. Connection pipes: 4 x Ø12 mm.
Airflow	Nozzle type S	F	No nozzle options, nozzle type is always F providing extensive airflow range with OMD airflow adjustment/control.
	Control type CN	MA	Manually adjustable airflow (CAV) (available when M=F)
		M1	Motorised airflow control 0...10 VDC (VAV).
		M2	Motorised airflow control Modbus RTU/ BACnet MSTP (VAV).
Room air velocity level	Velocity control (HVC) VC	N	No HVC function.
		Y	Yes, HVC function included.

Category	Feature (order code)	Option (order code)	Description
Exposed installation	Halton Coanda wings CE (See Fig. 13)	N	No Halton Coanda wings
		Y	Yes, installation included. Note: When selected, the RXP-600/1200 product height is 255 mm, with a d125 connection.

Table 2. Halton Rex RXP, Flexible model (RXP/F) and Autonomic model (RXP/A)

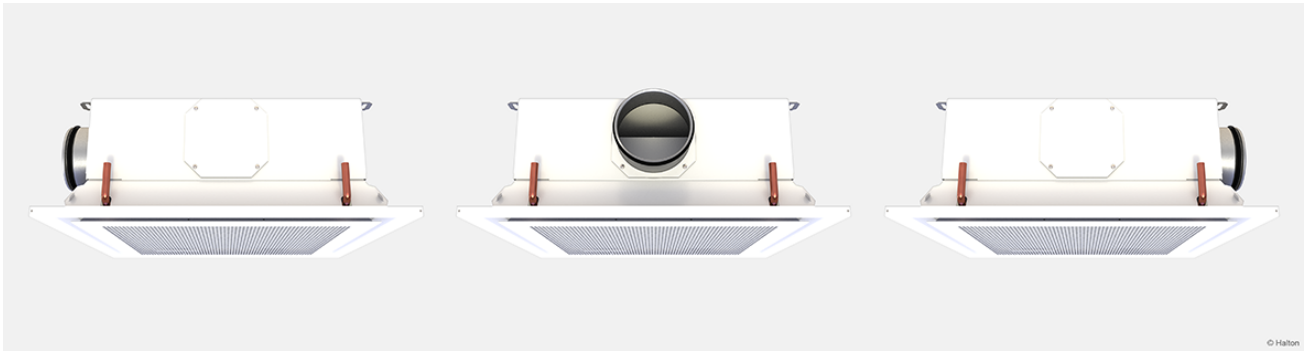


Fig. 12. Duct connection: Spigot positions left, straight, right

Halton Coanda wings (CE) for exposed installation



Fig. 13. Halton Rex RXP, Halton Coanda wings (CE) for exposed installation (1200 x 600)

For more detailed information on the order code, see section [Order code](#).

2.5 System package

Halton Workplace WRA room automation system package for Halton Rex RXP chilled beam, Standard model (RXP/S)

2.5.1 Overview

Halton Workplace WRA is part of the Halton Workplace solution offering.

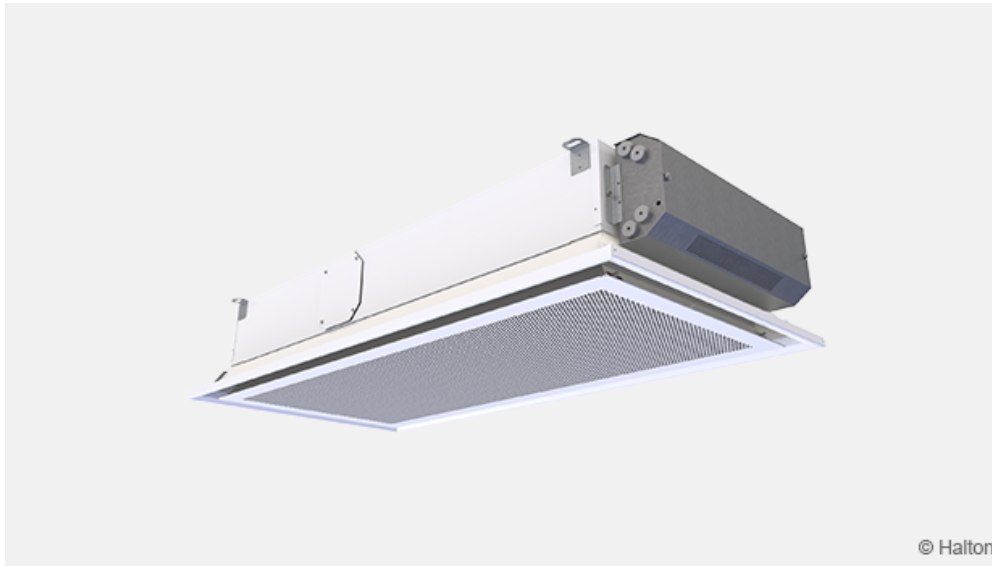


Fig. 14. Halton Workplace WRA room automation controller integrated to Halton Rex RXP chilled beam

Halton Workplace WRA is a controller especially designed for controlling the automation system of office spaces and meeting rooms. It is used for controlling the ventilation airflow, room temperature, and indoor air quality.

The Halton Workplace WRA room automation package consists of a controller and optional components depending on customer needs: a wall panel and sensors for temperature, CO₂, occupancy, pressure, and condensation.

There are options available for the controller and wall panel, depending on the number of controls and sensors required. The Halton Workplace WRA room automation controller is always combined with other Halton products for adaptable and high-level indoor climate.

Application area

- Controlling the ventilation airflow, room temperature, and indoor air quality in office spaces and meeting rooms
- The Halton Workplace WRA room automation controller is an important part of the Halton Workplace system, controlling room units and airflow control dampers
- The Halton Workplace system includes the following:
 - Room air conditioning applications with Halton Workplace WRA room automation controller:
 - Active chilled beams
 - Exhaust units
 - VAV dampers
 - Active VAV diffusers
 - Halton Max MLC airflow management damper
 - Halton Workplace WSO system optimiser

Key features

- Factory-tested controller and wiring, easy to install
- Pre-installed project-specific parameters, quick to commission
- Several operating modes based on occupancy, thermal comfort, and indoor air quality

- Enables fully flexible layout solutions for changing needs in office environments
- Highly energy-efficient and reliable system operation

2.5.2 Operating principle

The Halton Workplace WRA room automation controller operates with the Variable Air Volume (VAV) dampers, active chilled beams, radiant panels, and supply air diffusers of a Halton Workplace system. These are used for adjusting the ventilation airflow, room temperature, and indoor air quality in office spaces.

Each room unit in an office space can have its own dedicated Halton Workplace WRA room automation controller, or a single controller can control multiple room units. The Halton Workplace WRA room automation controller can automatically adjust the system according to the indoor environment level preferred by users. Each room unit having its own dedicated controller brings maximum flexibility.

2.5.3 Room automation

Halton Rex RXP active chilled beams with HAQ control and Halton PTS damper, controlled with Halton Workplace WRA room automation controllers

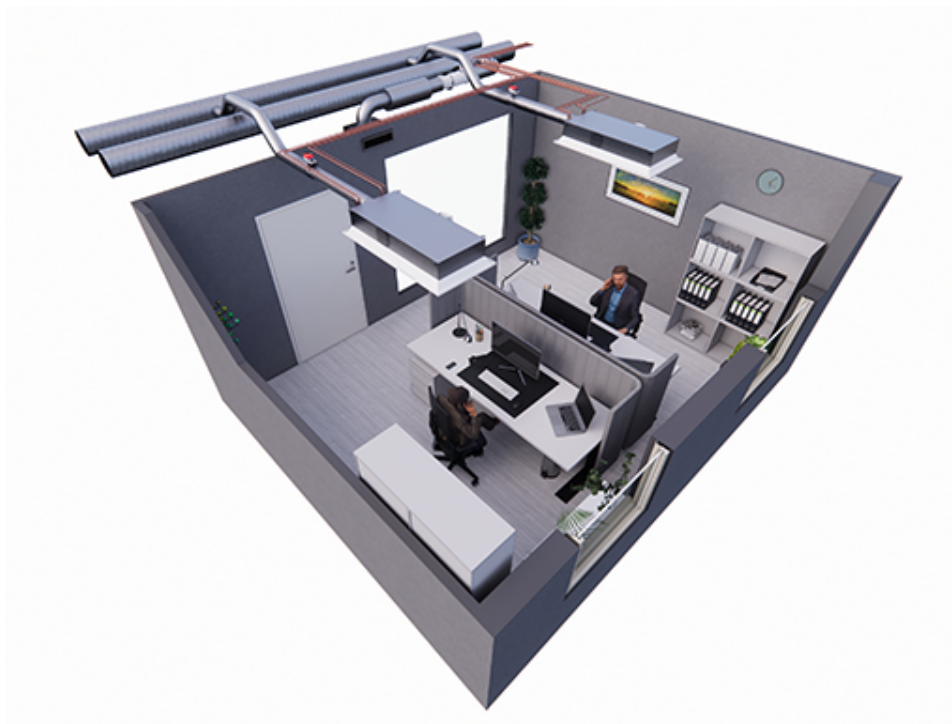


Fig. 15. Halton Rex RXP active chilled beams with HAQ control and Halton PTS damper, controlled with Halton Workplace WRA room automation controllers in a meeting room

Room automation description

In this configuration, two Halton Workplace WRA room automation controllers (type DXR2.E18-102A) control two Halton Rex RXP active chilled beams. Each chilled beam has heating and cooling valves, motorised Halton Air Quality (HAQ) control, as well as integrated CO₂, pressure and condensation sensors. A Halton PTS single-blade damper is used for controlling the minimum operating mode. The system also includes an exhaust VAV damper, window switch control, external occupancy sensor and a wall panel (type QMX3.P37) with a temperature sensor and display. One Halton Workplace WRA room automation controller can individually control up to four room units, and there can be several Halton Workplace WRA room automation controllers in

the room.

Design criteria for room automation

- Chilled beam has heating and cooling valves
- Chilled beam has motorised HAQ control
- Chilled beam has integrated CO₂, pressure, and condensation sensors
- External occupancy sensor
- Wall panel with temperature sensor and display
- Window switch control
- Optional Halton PTS damper for controlling minimum airflow
- Exhaust airflow control

Schematic drawing

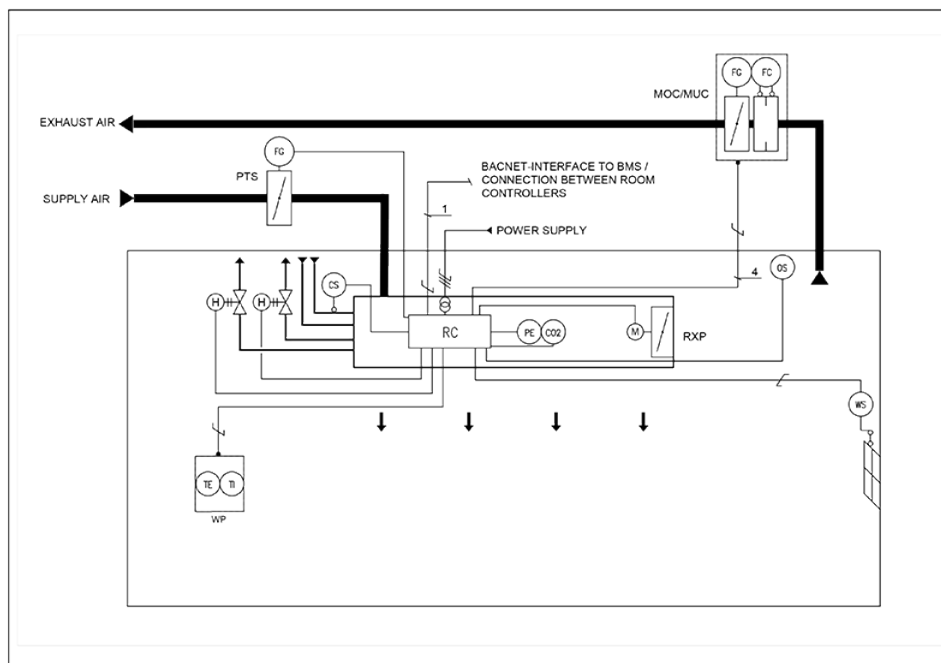


Fig. 16. Schematic drawing: Halton Rex RXP chilled beam (4-pipe) controlled with Halton Workplace WRA room automation controller

Equipment list

Code	Equipment
RC	Controller unit
FG	Airflow damper actuator
FC	Airflow measurement
H	Water valve actuator
CS	Condensation sensor
OS	Occupancy sensor

Code	Equipment
PE	Pressure sensor
CO2	CO ₂ sensor
WP	Wall panel
TE	Temperature sensor
TI	Temperature display
WS	Window switch control

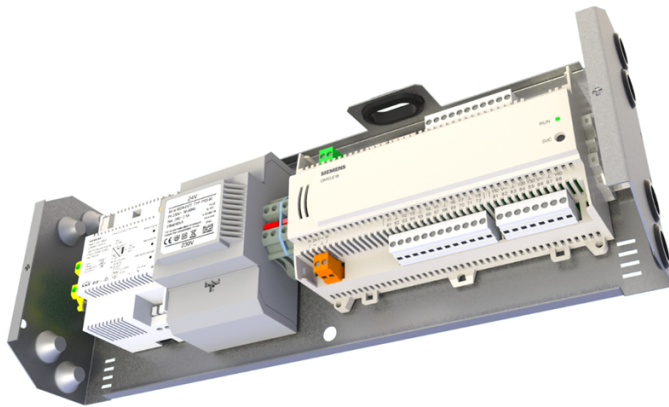


Fig. 17. Factory-installed Halton Workplace WRA room automation controller, type DXR2.E18-102A

Wiring diagram

For the wiring diagram of a similar configuration, see the product page of the Halton Workplace WRA room automation controller, section *Installation information*.

Components and order code examples for the system

- 2 x Active chilled beam: Halton Rex RXP
RXP/C-1200-S2, TC=H, AQ=MO, CO=SW, ZT=N
- 1 x Exhaust unit: Halton AGC exhaust grille + Halton PRL plenum for grilles
AGC/N-400-100 FS=CL, ME=A, FI=PN, CO=W, ZT=N+PRL/F-400-100-160
- 1 x VAV damper: Halton Max MUC or Halton Max MOC/G-160, MA=CS
- 2 x standby, shut-off damper: Halton PTS
PTS/A-125, MA=CS, MO=B4, ZT=N
- Automation package: 2 x Halton Workplace WRA room automation controller unit with related components
WRA/RXP-E81-H3-EX4, WP=37, LC=NA, SE=CI, SW=NC, ST=IA, SL=OI, PM=P1, TC=H, CV=SP5, RV=NA, ZT=N

Note: For more information, see the product page of the Halton Workplace WRA room automation controller.

2.5.4 Cooling and heating water valve selection

Water valve selection is done in the Halton Workplace WRA room automation system package. Water valve

sizing depends on the number of secondary and primary chilled beam units that are controlled with a single controller. One water valve is used to control the whole chilled beam group cooling or heating operated by one room controller. The water valve is sized for the whole group when there are multiple chilled beams controlled with single controller. There can be one primary chilled beam with a room controller and up to three secondary chilled beams. Water valve sizing for 1-4 chilled beams is shown below.

Number of chilled beams (pcs.)	Water valve type	Size for cooling (DN)	Size for heating (DN)	Installation
1	ABQM	DN15	DN15	Integrated to chilled beam
2	ABQM	DN20	DN15	Loose
3	ABQM	DN20	DN15	Loose
4	ABQM	DN25	DN15	Loose

Number of chilled beams (pcs.)	Water valve type	Size for cooling (DN)	Size for heating (DN)	Installation
1	VPP46..	DN15	DN15	Loose
2	VPP46..	DN20	DN15	Loose
3	VPP46..	DN20	DN15	Loose
4	VPP46..	DN25	DN15	Loose

2.6 Quick selection

Airflow

Halton Rex RXP, Standard model

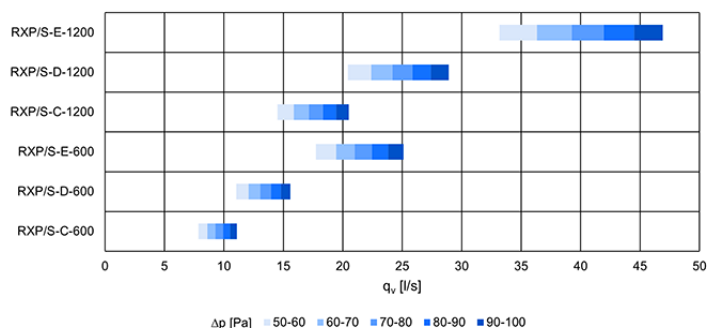


Fig. 18. Airflow ranges in l/s for Halton Rex RXP, Standard model without HAQ/with HAQ closed with different static chamber pressure levels

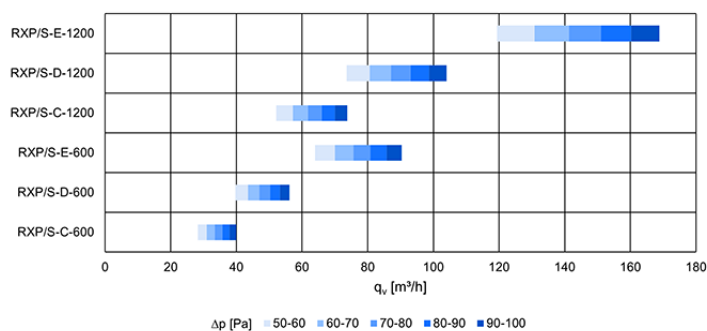


Fig. 19. Airflow ranges in m³/h for Halton Rex RXP, Standard model without HAQ/with HAQ closed with different static chamber pressure levels

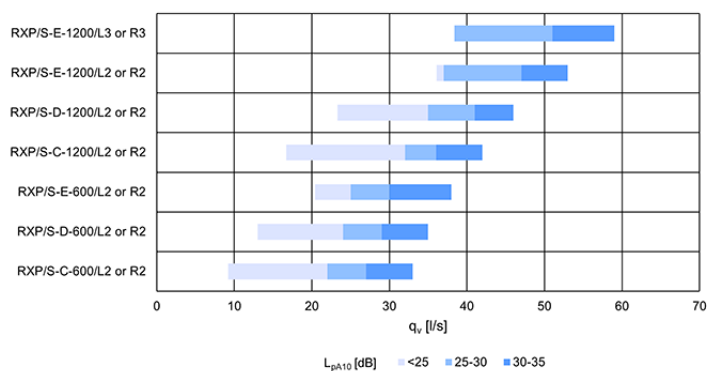


Fig. 20. Airflow ranges in l/s for Halton Rex RXP, Standard model with HAQ @70 Pa total pressure

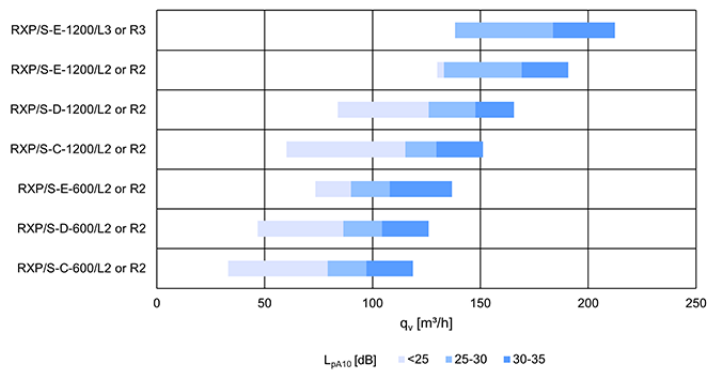


Fig. 21. Airflow ranges in m^3/h for Halton Rex RXP, Standard model with HAQ @70 Pa total pressure

Halton Rex RXP, Flexible and Autonomic models

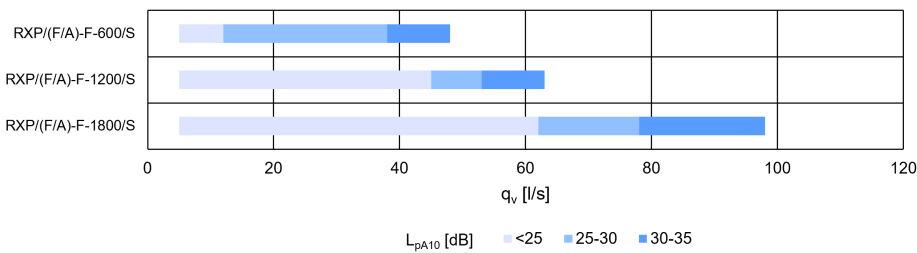


Fig. 22. Airflow ranges in l/s for Halton Rex RXP, Flexible and Autonomic models @70 Pa total pressure

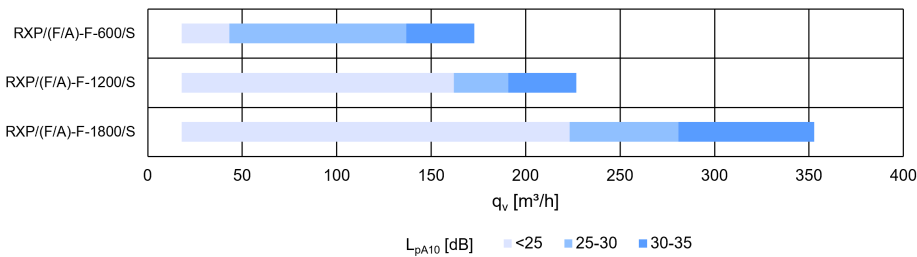


Fig. 23. Airflow ranges in m^3/h for Halton Rex RXP, Flexible and Autonomic models @70 Pa total pressure

Cooling capacity

Halton Rex RXP, Standard model

Product model with HAQ/OMD	Inlet/outlet water temp. [°C]	Room temp. [°C]	Total pressure [Pa]	Water mass flow [kg/s]	Airflow 30 dBA [l/s]	Capacity [W]		
						Water	Air (18°C)	Total
RXP/S-C-600	15/17	25	75	0.03	27	249	229	478
RXP/S-D-600				0.035	29	290	246	537
RXP/S-E-600				0.047	30	390	255	645
RXP/S-C-1200	15/18	25	75	0.038	36	483	306	789

Product model with HAQ/OMD	Inlet/outlet water temp. [°C]	Room temp. [°C]	Total pressure [Pa]	Water mass flow [kg/s]	Airflow 30 dBA [l/s]	Capacity [W]		
						Water	Air (18°C)	Total
RXP/S-D-1200				0.047	42	596	357	953
RXP/S-E-1200				0.055	48	687	408	1095

Halton Rex RXP, Flexible and Autonomic models

Product model with HAQ/OMD	Inlet/outlet water temp. [°C]	Room temp. [°C]	Total pressure [Pa]	Water mass flow [kg/s]	Airflow 30 dBA [l/s]	Capacity [W]		
						Water	Air (18°C)	Total
RXP/F-F-600 or RXP/A-F-600	15/17	25	75	0.049	36	412	306	718
RXP/F-F-1200 or RXP/A-F-1200	15/18			0.047	56	595	476	1071
RXP/F-F-1800 or RXP/A-F-1800	15/18			0.081	78	1023	663	1685

2.7 Structure and materials

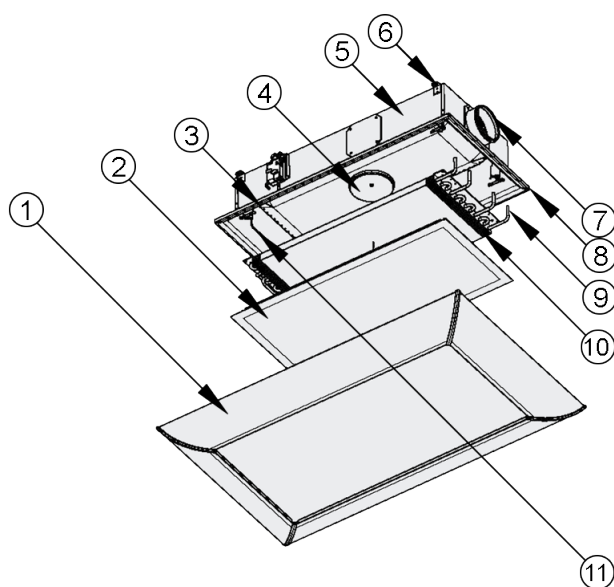


Fig. 24. Halton Rex RXP, structure.

No.	Part	Description	Note
1	Halton Coanda wings	Pre-painted galvanised steel, polyester painted, white (RAL9003)	Optional part
2	Front panel	Pre-painted galvanised steel, polyester painted, white (RAL9003)	Special colours available
3	Nozzels	Galvanised steel	-
4	HAQ control	Painted galvanised steel, Optional part in Halton Rex RXP, Standard model (RXP/S) depending on HAQ selection and always included in Halton Rex RXP, Flexible (RXP/F) and Autonomic (RXP/A) models linked to the OMD control models.	Halton Rex RXP-1800 is equipped with two HAQ control valves.
5	Plenum	Pre-painted galvanised steel, polyester painted, white (RAL9003)	-
6	Brackets	Galvanised steel	-
7	Spigot	Galavanised steel	-
8	Frame	Pre-painted galvanised steel, polyester painted, white (RAL9003)	Special colours available
9	Connection pipes	Copper. Ø12 mm with a wall thickness of 0.9–1.0 mm, fulfilling the requirements of European Standard EN 1057:1996.	-
10	Coil/Heat exchanger	Pipes: copper and Fins: aluminium	-
11	Pressure measurement tube	Polyvinyl chloride	-

2.8 Dimensions and weight

The dimensions are given in millimetres [mm].


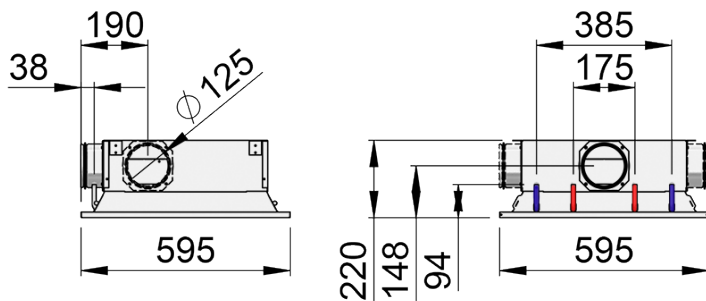


Fig. 25. Halton Rex RXP, Standard model dimensions (RXP/S-600)

Note: When selected, product height is 255 mm.

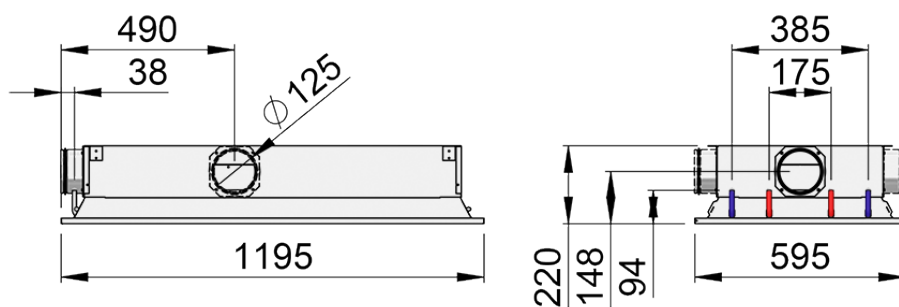

Note: When selected, product height is 255 mm.

Fig. 26. Halton Rex RXP, Standard model dimensions (RXP/S-1200)

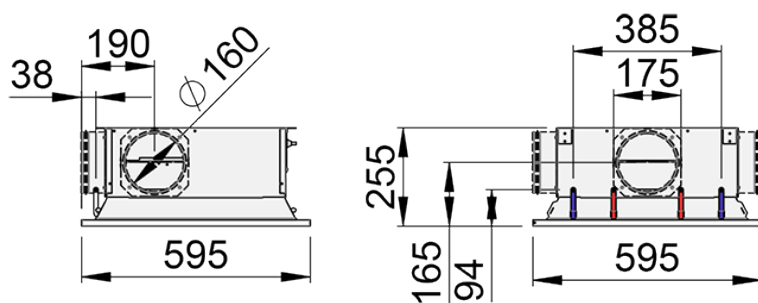


Fig. 27. Halton Rex RXP, Flexible and Autonomic models dimensions (RXP/F-600 or RXP/A-600)

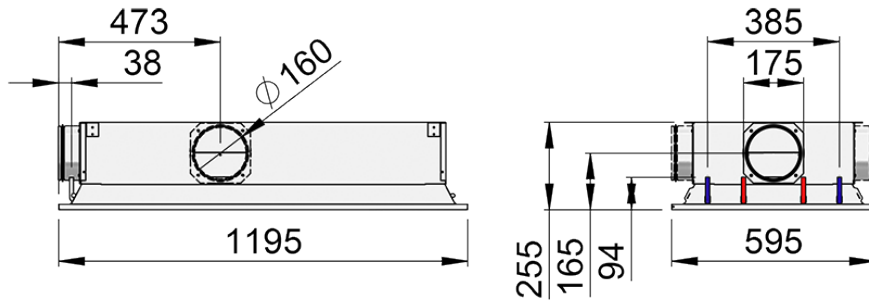


Fig. 28. Halton Rex RXP, Standard, Flexible and Autonomic models dimensions (RXP/S, RXP/F-1200 or RXP/A-1200)

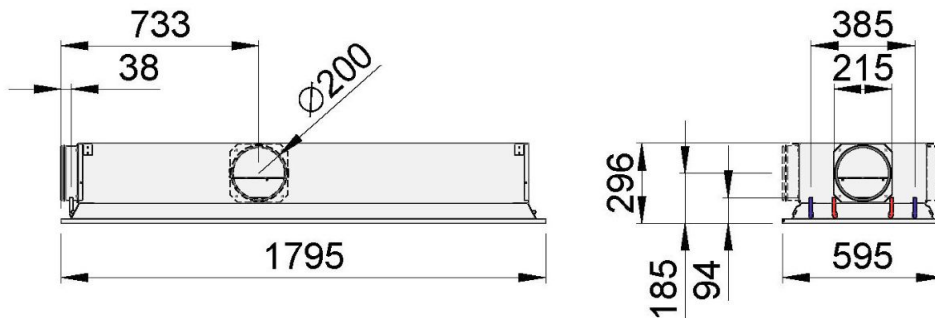


Fig. 29. Halton Rex RXP, Flexible and Autonomic models dimensions (RXP/S, RXP/F-1800 or RXP/A-1800)

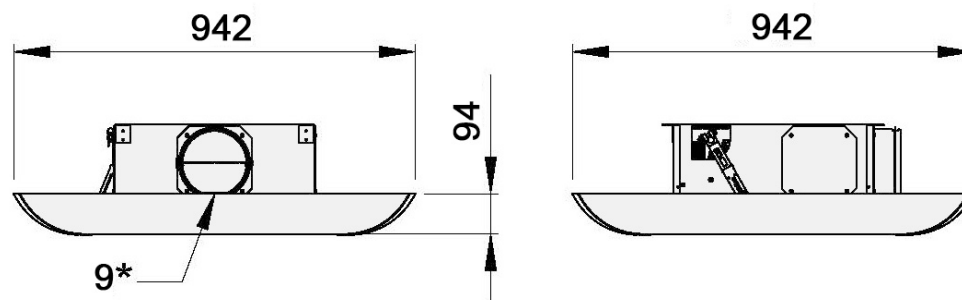


Fig. 30. Halton Rex RXP, Flexible and Autonomic models with Halton Coanda wings (RXP/S (with d125 and d160 duct connection), RXP/F-600 or RXP/A-600)

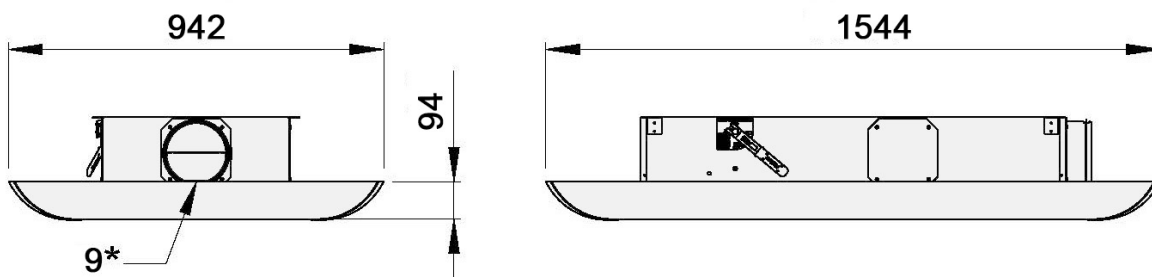


Fig. 31. Halton Rex RXP, Flexible and Autonomic models with Halton Coanda wings (RXP/S (with d125 and d160 duct connection), RXP/F-1200 or RXP/A-1200)

* The distance between the top of the Halton Coanda wings overlapping the d160 duct connection is 9 mm. There is a similar distance in the RXP-1800 with the d200 duct connection. In RXP/S, with the d125 duct

connection, there is no overlap.

Weight

Halton Rex RXP, Standard model

Product	CN model	Dry mass (excl. water) [kg]	Water volume [l]
RXP/S*-600	NA	10.5	0.5
	MA	11.4	
	M1	11.6	
RXP/S*-1200	NA	20.9	1.2
	MA	21.8	
	M1	22.1	

* Nozzle type (S), see [Order code](#) section.

Halton Rex RXP, Flexible and Autonomic models

Product	CN model	Dry mass (excl. water) [kg]	Water volume [l]
RXP/F-F-600 or RXP/A-F-600	MA	16.5	0.5
	M1 or M2	17.0	
RXP/F-F-600 or RXP/A-F-600 (CE = Y**)	MA	20.9	0.5
	M1 or M2	21.4	
RXP/F-F-1200 or RXP/A-F-1200	MA	30.4	1.2
	M1 or M2	31.0	
RXP/F-F-1200 or RXP/A-F-1200 (CE = Y**)	MA	37.2	1.2
	M1 or M2	37.8	
RXP/F-F-1800 or RXP/A-F-1800	MA	45.5	1.6
	M1 or M2	46.1	

** Halton Coanda wings (CE), see [Order code](#) section.

2.9 Specification

Active chilled beam with CAV/VAV airflow function and four-directional air distribution, used for cooling, heating, and ventilation in suspended ceilings, fulfilling the following requirements:

Function

- Three product models with adjustable airflow using manual CAV or motorised VAV actuators
 - Standard product model equipped with manual CAV or motorised (0...10 VDC) VAV actuators for boost airflow control and pressure-dependent operation
 - Flexible product model equipped with manual CAV or motorised (0...10 VDC) VAV actuators for 0-100% airflow control and pressure-dependent operation
 - Autonomic product model equipped with motorised (0...10 VDC or Modbus RTU/BACnet MSTP) VAV actuators for 0-100% airflow control and pressure-independent operation
- The throw pattern expanded to corners automatically in higher airflow settings maintaining uniform supply air throw length.
- Halton Coanda wings, designed for exposed installation, ensure proper air distribution and prevent drafts when no ceiling surface is present.
- Flexible and Autonomic product models can be equipped with Halton Velocity Control (HVC) for adjusting room air velocity conditions individually in all four directions.

Structure

- Integral recirculation air path through the perforated front panel.
- The front panel is removable allowing for general maintenance and cleaning.
- Front panel removable without the need for special tools.
- Four-directional air distribution.
- Unit width 595 mm, height 220 mm / 255 mm / 296 mm.
- Inlet duct diameter 125 mm, 160 mm and 200 mm.
- Duct connection position is changeable without special tools.
- Measurement tap to allow airflow measurement.
- Pipework's maximum operating pressure is 1.0 MPa.

Materials

- Plenum, frame, Halton Coanda wings and front panel are manufactured from galvanised steel.
- All visible parts are white, painted in RAL 9003, 20% gloss.
- All pipes are manufactured from copper.
- Water connection pipes have a wall thickness of 0.9–1.0 mm.
- All pipe joints are soldered.
- All pipe joints are pressure-tested at the factory.
- Heat exchanger fins are manufactured from aluminium.

Packaging and identification

- The product is protected by a removable plastic coating.
- The duct connection and pipe ends remain sealed during transport.
- The product is identified by a serial number printed on labels attached both to the product and the

cardboard box.

2.10 Order code

RXP-M-S-L-E, SP-TC-CT-CN-VC-CE-CO-ZT

Main options for Halton Rex RXP	
M = Model	
F	Flexible
A	Autonomic
S	Standard
S = Nozzle type	
C	Medium
D	Large
E	Extra large
F	Flex
L = Length [mm]	600 , 1200, 1800
E = Duct connection	
S2	Straight (Ø125)
R2	Right (Ø125)
L2	Left (Ø125)
S3	Straight (Ø160)
R3	Right (Ø160)
L3	Left (Ø160)
S4	Straight (Ø200)
R4	Right (Ø200)
L4	Left (Ø200)

Other options and accessories	
SP = System package	
N	No
Y	Yes
TC = Cooling / Heating functions (Coil type)	
C	Cooling

Other options and accessories	
H	Cooling and heating
CT = Cooling / Heating functions (Coil type)	
S	Air and water connections at the same end
O	Water connections at the opposite end
CN = Control types	
NA	Not assigned
MA	Manual
M1	Motorised (0...10 VDC)
M2	Motorised (Modbus RTU/BACnet MSTP)
VC = Velocity control (HVC)	
N	No
Y	Yes
CE = Halton Coanda wings (exposed installation)	
N	No
Y	Yes
CO = Colour	
SW	Signal white (RAL 9003)
X	Special colour (RAL xxxx)
ZT = Tailored product	
N	No
Y	Yes (ETO)

Sub products for Halton Rex RXP	
System package	Halton Workplace WRA
Room exhaust	Halton Max MOC, VAV damper
Room exhaust	Halton Max MUC, VAV damper

Order code example

RXP-S-E-1200-S2, SP=N, TC=C, CT=S, CN=NA, VC=N, CE=N, CO=SW, ZT=N

3 Design information

3.1 Design considerations

3.1.1 Installation

When planning the orientation of the Halton Rex RXP chilled beam, the locations of the supply air and water circuit connections must be considered. The supply air spigot can be on either side of the unit or at the same end as the water connections. The location can be easily changed on-site, if needed. There are product model options with Halton Rex RXP 600, Flexible, and Autonomic models that allow water connections at the same or opposite end as the straight air connections.

The HAQ control actuator (optional) location must also be considered to ensure access to the airflow adjustment/actuator. The actuator is in the middle of the left side of the unit in the Halton Rex RXP chilled beam, Standard model. Similarly, the actuator location on the OMD control (manual or motorised models) must be considered to ensure access to the airflow adjustment/actuator. The actuator is located at the end of the left side of the unit in the Halton Rex RXP chilled beam, Flexible and Autonomic models. See the figures below showing the location and details in the section "Operating principle" of "Halton Rex RXP, chilled beam - Technical description".

The Halton Rex RXP chilled beam Standard/Flexible model can be installed directly to the ceiling surface (H = 220 mm / 225 mm / 296 mm standard/flexible model). The Autonomic model can be installed 10 mm from the ceiling surface due to the space required by the actuator (H = 225 mm autonomic model + 10 mm space). Installation to the suspended ceiling can be done using threaded drop rods (8 mm). The brackets for ceiling installation are located at the sides of the unit.

The Halton Rex RXP chilled beam can be integrated with a standard T-bar ceiling measuring 600 x 600 mm. The height of the unit's edges is 16 mm. If other suspended ceiling integrations are needed, please contact Halton sales for further information.

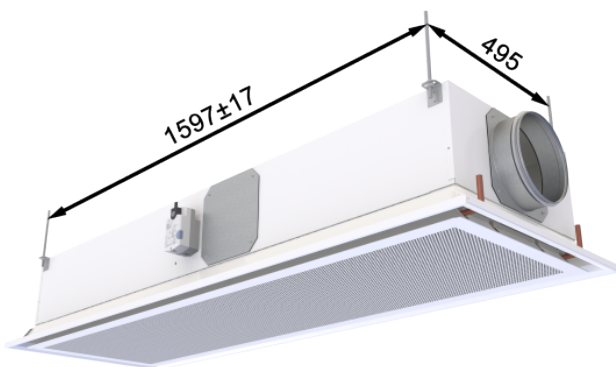


Fig. 32. Installation points of Halton Rex RXP 1800, Flexible and Autonomic models and the location of the actuator.

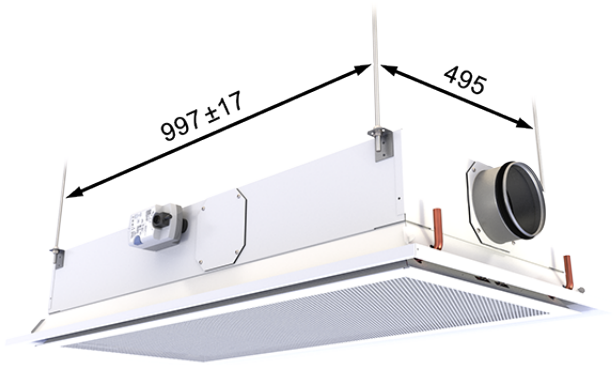


Fig. 33. Installation points of Halton Rex RXP 1200, Standard, Flexible and Autonomic models. The location of the actuator in Halton Rex RXP 1200, Standard model

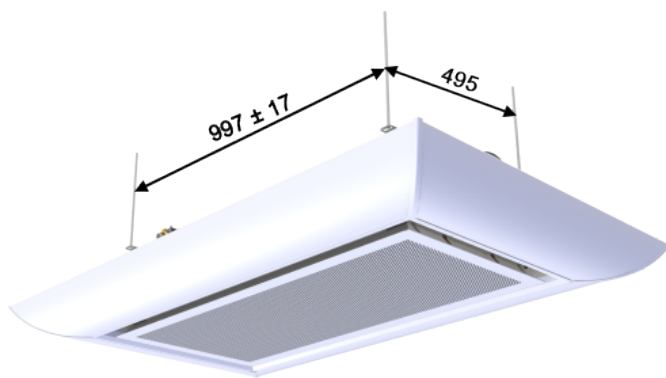


Fig. 34. Installed Halton Coanda wings for Halton Rex RXP 1200, Flexible and Autonomic models

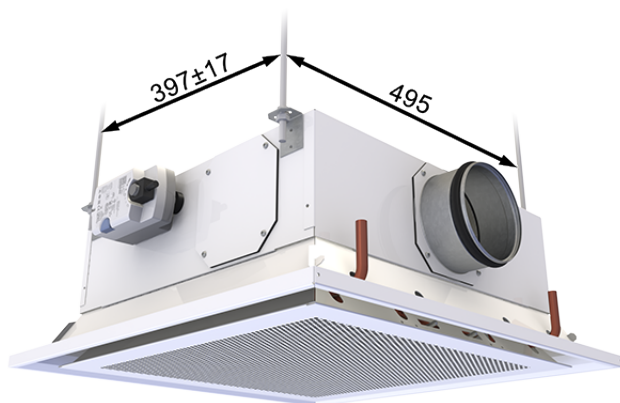


Fig. 35. Installation points and the location of the actuator of Halton Rex RXP 600, Standard model

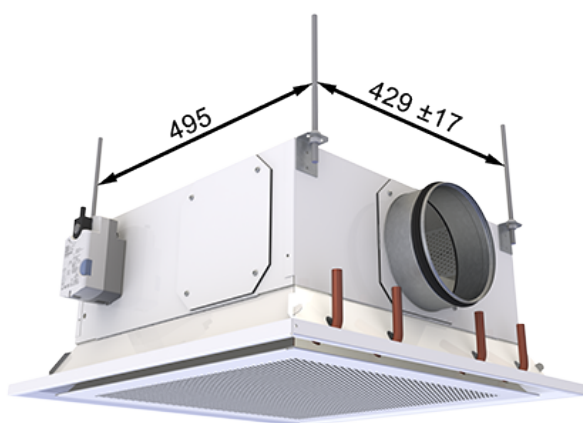


Fig. 36. Installation points and the location of the actuator of Halton Rex RXP 600, Flexible and Autonomic models

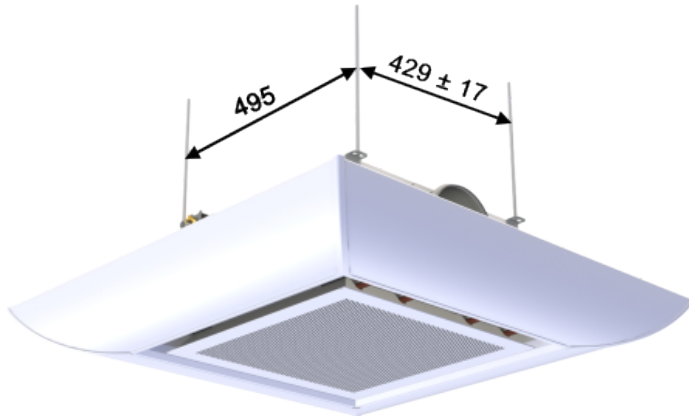


Fig. 37. Installed Halton Coanda wings for Halton Rex RXP 600, Flexible and Autonomic models

It is recommended that the main pipelines of the cooling and heating water circuits are installed above the level of the heat exchanger to enable venting of the pipework.

The maximum operating pressure for chilled/hot water pipework is 1.0 MPa.

Installation of Coanda wings

The Coanda wing can be lifted around the Halton Rex RXP lower frame. When the inside vertical flanges on the Coanda wing are flush with its lower frame vertical flanges, install the 8 edge clips through the slots in the wing into the vertical flanges. Secure the wing installation by turning the horizontal flaps 180 degrees over its frame.

3.1.2 Commissioning

Adjustment of the cooling capacity

The recommended cooling water mass flow rate is 0.02–0.10 kg/s, resulting in a temperature rise of 1–4 °C in the heat exchanger. To avoid condensation, the recommended minimum inlet water temperature of the heat exchanger is 14–16 °C.

Adjustment of the heating capacity

The recommended heating water mass flow rate is 0.01–0.04 kg/s, resulting in a temperature drop of 5–15 °C in the heat exchanger. The maximum inlet water temperature of the heat exchanger is 35 °C.

Balancing and control of water flow rates

The water mass flow rates of the Halton Rex RXP chilled beam are balanced with adjustment valves installed on the outlet side of the water loops. The cooling or heating capacity of the Halton Rex RXP chilled beam is controlled by regulating the water mass flow rate.

Adjustment of the supply airflow rate

With a Halton Rex RXP chilled beam Standard model (RXP/S) that does not have the Halton Air Quality (HAQ) control, the airflow depends on the chamber pressure and the selected nozzle. With the HAQ control included,

the position of the HAQ control must also be taken into considered. The k-factors are given in the table below.

With a Halton Rex RXP chilled beam Flexible model (RXP/F), the position of the OMD control must be taken into account as shown in the table below.

The chamber pressure (RXP/S) or the OMD pressure (RXP/F) can be measured from a measurement tap under the front panel.

The total airflow rate is calculated using the formula below.

$$q_v = k\sqrt{\Delta p_m}$$

where

q_v	Airflow rate [l/s]
Δp_m	Measured pressure [Pa]
k	The k-factor given as a function of mounting and diameter (see the tables below)

Halton Rex RXP, Standard model

Position of HAQ control	Control signal voltage [V]	k-factor [l/s], total airflow (Standard model)					
		600			1200		
		C*	D*	E*	C*	D*	E*
0 / closed/ no HAQ	0-1	1.11	1.56	2.51	2.05	2.89	4.69
0.5	1.5	1.39	1.84	2.79	2.33	3.17	4.97
1	2	1.67	2.12	3.07	2.61	3.45	5.25
1.5	2.5	1.94	2.39	3.34	2.88	3.72	5.52
2	3	2.21	2.66	3.61	3.15	3.99	5.79
2.5	3.5	2.47	2.92	3.87	3.41	4.25	6.05
3	4	2.72	3.17	4.12	3.66	4.50	6.30
3.5	4.5	2.97	3.42	4.37	3.91	4.75	6.55
4	5	3.21	3.66	4.61	4.15	4.99	6.79
4.5	5.5	3.44	3.89	4.84	4.38	5.22	7.02
5	6	3.67	4.12	5.07	4.61	5.45	7.25
5.5	6.5	3.89	4.34	5.29	4.83	5.67	7.47
6	7	4.11	4.56	5.51	5.05	5.89	7.69
6.5	7.5	4.23	4.77	5.72	5.26	6.10	7.90
7	8	4.52	4.97	5.92	5.46	6.30	8.10

Position of HAQ control	Control signal voltage [V]	k-factor [l/s], total airflow (Standard model)					
		600			1200		
		C*	D*	E*	C*	D*	E*
7.5	8.5	4.72	5.17	6.12	5.66	6.50	8.30
8	9	4.91	5.36	6.31	5.85	6.69	8.49
8.5	9.5	5.10	5.55	6.50	6.04	6.88	8.68
9	10	5.28	5.73	6.68	6.22	7.06	8.86

Table 3. Halton Rex RXP, Standard model: k-factors with different HAQ control positions in l/s

*Nozzle types: C = Medium, D = Large, E = Extra large

Position of HAQ control	Control signal voltage v	k-factor [m ³ /h], total airflow (Standard model)					
		600			1200		
		C*	D*	E*	C*	D*	E*
0 / closed / no HAQ	0-1	4.00	5.62	9.04	7.38	10.40	16.88
0.5	1.5	5.02	6.64	10.06	8.40	11.43	17.91
1	2	6.02	7.64	11.06	9.40	12.43	18.91
1.5	2.5	7.00	8.62	12.04	10.38	13.40	19.88
2	3	7.95	9.57	12.99	11.34	14.36	20.84
2.5	3.5	8.88	10.50	13.92	12.27	15.29	21.77
3	4	9.80	11.42	14.84	13.18	16.20	22.68
3.5	4.5	10.68	12.30	15.72	14.07	17.09	23.57
4	5	11.55	13.17	16.59	14.93	17.96	24.44
4.5	5.5	12.39	14.01	17.43	15.78	18.80	25.28
5	6	13.22	14.84	18.26	16.60	19.62	26.10
5.5	6.5	14.02	15.64	19.06	17.40	20.42	26.90
6	7	14.79	16.41	19.83	18.18	21.20	27.68
6.5	7.5	15.55	17.17	20.59	18.93	21.96	28.44
7	8	16.28	17.90	21.32	19.67	22.69	29.17
7.5	8.5	16.99	18.61	22.03	20.38	23.40	29.88
8	9	17.68	19.30	22.72	21.07	24.09	30.57
8.5	9.5	18.35	19.97	23.39	21.73	24.76	31.24
9	10	18.99	20.61	24.03	22.38	25.40	31.88

Table 4. Halton Rex RXP, Standard model: k-factors with different HAQ control positions in m³/h

*Nozzle types: C = Medium, D = Large, E = Extra large

Halton Rex RXP, Flexible model

Control signal voltage for electric actuator [V]	k-factor [l/s], total airflow (Flexible model)		
	600	1200	1800
0.0	0.12	0.14	0.16
0.5	0.19	0.34	0.34
1.0	0.27	0.54	0.52
1.5	0.84	1.04	1.38
2.0	1.42	1.55	2.24
2.5	1.55	2.11	2.98
3.0	1.69	2.66	3.73
3.5	1.74	3.05	4.07
4.0	1.78	3.44	4.4
4.5	2.21	4.05	5.07
5.0	2.64	4.67	5.75
5.5	3.12	5.23	6.81
6.0	3.60	5.79	7.87
6.5	4.10	6.38	9.15
7.0	4.60	6.97	10.42
7.5	5.05	7.49	11.52
8.0	5.50	8.02	12.63
8.5	5.88	8.47	13.68
9.0	6.25	8.92	14.72
9.5	6.38	9.11	14.92
10.0	6.51	9.30	15.11

Table 5. Halton Rex RXP, Flexible model: k-factors with different OMD control positions in l/s

Note: For the k-factors of the products delivered before 30.06.2025, refer to the " Halton Rex RXP, chilled beam - k-factors before 30.06.2025 " document in the "Downloads" section.

Control signal voltage for electric actuator [V]	k-factor [m ³ /h], total airflow (Flexible model)		
	600	1200	1800
0.0	0.42	0.51	0.59
0.5	0.69	1.22	1.23
1.0	0.97	1.94	1.87

Control signal voltage for electric actuator [V]	k-factor [m ³ /h], total airflow (Flexible model)		
	600	1200	1800
1.5	3.03	3.76	4.96
2.0	5.10	5.59	8.05
2.5	5.60	7.58	10.74
3.0	6.09	9.57	13.44
3.5	6.25	10.98	14.64
4.0	6.42	12.39	15.84
4.5	7.97	14.59	18.27
5.0	9.52	16.80	20.70
5.5	11.23	18.81	24.52
6.0	12.95	20.83	28.35
6.5	14.76	22.96	32.92
7.0	16.58	25.09	37.50
7.5	18.20	26.97	41.49
8.0	19.82	28.86	45.47
8.5	21.16	30.48	49.24
9.0	22.50	32.11	53.00
9.5	22.98	32.79	53.70
10.0	23.45	33.48	54.40

Table 6. Halton Rex RXP, Flexible model: k-factors with different OMD control positions in m³/h

Note: For the k-factors of the products delivered before 30.06.2025, refer to the " Halton Rex RXP, chilled beam - k-factors before 30.06.2025 " document in the "Downloads" section.

Halton Rex RXP, Autonomic model

Control signal voltage for electric actuator [V]	k-factor [l/s], total airflow (Autonomic model)		
	600	1200	1800
0.0	0.08	0.21	0.15
0.5	0.24	0.43	0.45
1.0	0.40	0.64	1.31
1.5	0.89	1.01	1.98
2.0	1.38	1.37	2.63
2.5	1.51	1.76	3.29
3.0	1.65	2.16	3.88

Control signal voltage for electric actuator [V]	k-factor [l/s], total airflow (Autonomic model)		
	600	1200	1800
3.5	1.69	2.58	4.22
4.0	1.73	3.01	4.35
4.5	2.01	3.38	4.81
5.0	2.29	3.76	5.74
5.5	2.73	4.23	6.74
6.0	3.18	4.70	7.9
6.5	3.64	5.23	9.0
7.0	4.09	5.75	10.02
7.5	4.51	6.27	11.05
8.0	4.93	6.79	12.15
8.5	5.31	7.28	13.11
9.0	5.69	7.77	14.1
9.5	6.05	8.22	14.91
10.0	6.40	8.68	15.56

Table 7. Halton Rex RXP, Autonomic model: k-factors with different OMD control positions in l/s

Note: For the k-factors of the products delivered before 30.06.2025, refer to the " Halton Rex RXP, chilled beam - k-factors before 30.06.2025 " document in the "Downloads" section.

Control signal voltage for electric actuator [V]	k-factor [m ³ /h], total airflow (Autonomic model)		
	600	1200	1800
0.0	0.29	0.75	0.52
0.5	0.86	1.53	1.64
1.0	1.44	2.31	4.71
1.5	3.21	3.62	7.13
2.0	4.98	4.94	9.47
2.5	5.45	6.35	11.86
3.0	5.92	7.77	13.95
3.5	6.07	9.30	15.19
4.0	6.22	10.84	15.65
4.5	7.23	12.18	17.32
5.0	8.23	13.53	20.65
5.5	9.84	15.23	24.28
6.0	11.44	16.93	28.44

Control signal voltage for electric actuator [V]	k-factor [m^3/h], total airflow (Autonomic model)		
	600	1200	1800
6.5	13.09	18.82	32.4
7.0	14.74	20.71	36.06
7.5	16.24	22.58	39.77
8.0	17.74	24.45	43.73
8.5	19.11	26.20	47.21
9.0	20.49	27.95	50.77
9.5	21.77	29.59	53.67
10.0	23.05	31.23	56.01

Table 8. Halton Rex RXP, Autonomic model: k-factors with different OMD control positions in m^3/h

Note: For the k-factors of the products delivered before 30.06.2025, refer to the " Halton Rex RXP, chilled beam - k-factors before 30.06.2025 " document in the "Downloads" section.

Example 1:

The measured static chamber pressure is 70 Pa for RXP/S-E-600, and the position of the HAQ control is 3. The total airflow rate is $4.12 \cdot \sqrt{(70)} \approx 34.3 \text{ l/s}$.

Example 2:

The OMD pressure measured from the measurement tap in RXP/F-F-600 S3 is 75 Pa. RXP/F-F-600 S3 is equipped with the manual actuator. The positions of the manual actuator can be moved with the handle shown in Fig. 27. When the handle is moved to the position 3 (position of the handle according to the scale in the sticker behind the handle). For calculating the total airflow rate, the k-value is taken from Table 5, and calculated with the equation $1.95 \cdot \sqrt{75} \approx 17 \text{ l/s}$.

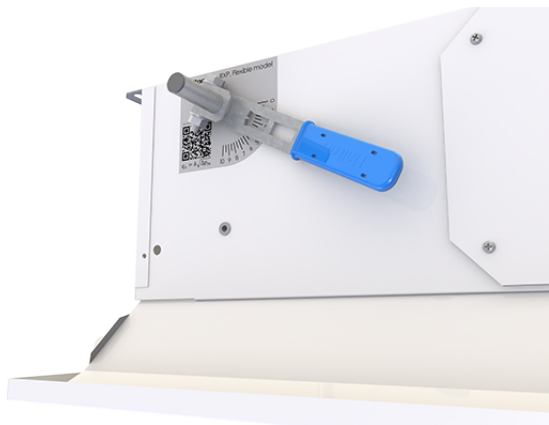


Fig. 38. Adjustment of the manual actuator position in Halton Rex RXP, Flexible model

3.1.3 Maintenance

The front panel of the Halton Rex RXP chilled beam is removable, allowing for general maintenance and cleaning.

Halton Coanda wings

Halton Coanda wings require no or minimal maintenance, such as

- Cleaning to remove visible dust.
- Inspecting them to ensure unobstructed airflow and correct alignment.
- Secure fixing and a proper surface finish.

For more information, please download the Halton Rex RXP, Standard model – Installation, commissioning and maintenance guide.

4 Technical reference data

4.1 Connection diagrams

Halton Rex RXP, Standard model

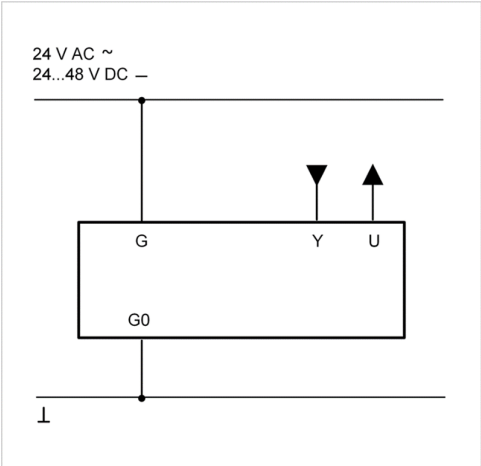


Fig. 39. Connection diagram for Halton Rex RXP, Standard model HAQ control

Connection	No.	Colour	Comment
G	1	Red	24 V AC/24...48 V DC
G0	2	Black	Ground
Y	8	Grey	0...10 V DC. Control signal in for HAQ position. The voltage corresponds to the HAQ openings and k-factors.
U	9	Pink	0...10 V DC. Feedback signal out indicating the HAQ position.

Halton Rex RXP, Flexible model

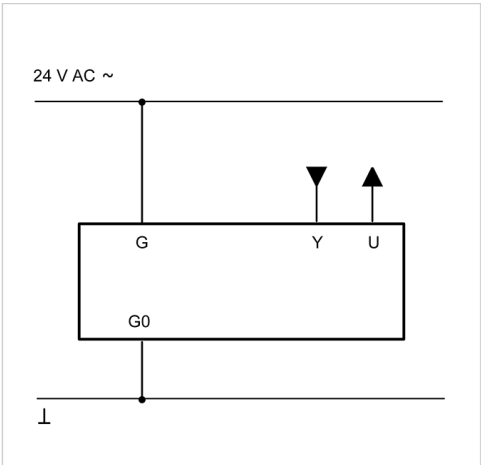


Fig. 40. Connection diagram for Halton Rex RXP, Flexible model OMD control

Connection	No.	Colour	Comment
G	1	Red	24 V AC

Connection	No.	Colour	Comment
G0	2	Black	Ground
Y	8	Grey	0...10 V DC. Control signal in for OMD position. The voltage corresponds to the OMD openings and k-factors.
U	9	Pink	0...10 V DC. Feedback signal out indicating the OMD position.

Halton Rex RXP, Autonomic model

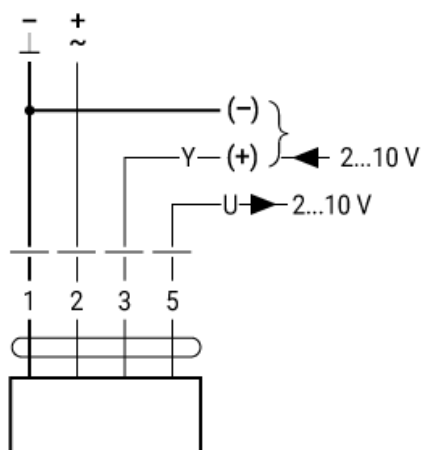


Fig. 41. Connection diagram analog for Halton Rex RXP, Autonomic model

No.	Designation	Cable colour	Function
1	⊥ -	Black	AC/DC 24 V supply
2	~ +	Red	
3	◀ Y	White	Reference signal/Override/Sensor
5	▶ U	Orange	- Actual value signal - MP-Bus connection

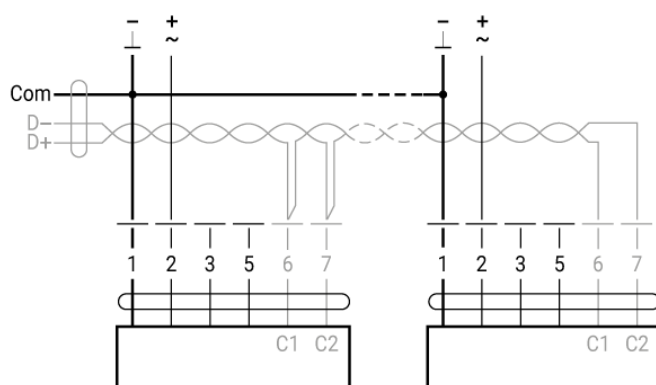


Fig. 42. Connection diagram BACnet/Modbus for Halton Rex RXP, Autonomic model

No.	Designation	Cable colour	Function
1	⊥ -	Black	AC/DC 24 V supply
2	~ +	Red	
6	D-	Pink	BACnet/Modbus (RS485)
7	D+	Grey	

Terminals

Terminal	Name	Comment
1	GND	Ground
2	24 V DC/AC	Power supply input
3	GND	Ground
4	Standard RS-485 B	Data receive/send line B -
5	Standard RS-485 A	Data receive/send line A +
6	GND	Ground
7	AI3	Input for NTC 10k temperature sensor
8	GND	Ground
9	AI1	Input for airflow or damper control signal
10	GND	Ground
11	AO1	Output for airflow or damper feedback signal
12	AI2	Analog actuator feedback signal
13	AO2	Analog actuator reference signal
14	GND	Ground
15	24 V DC/AC	Power supply output for the analog actuator